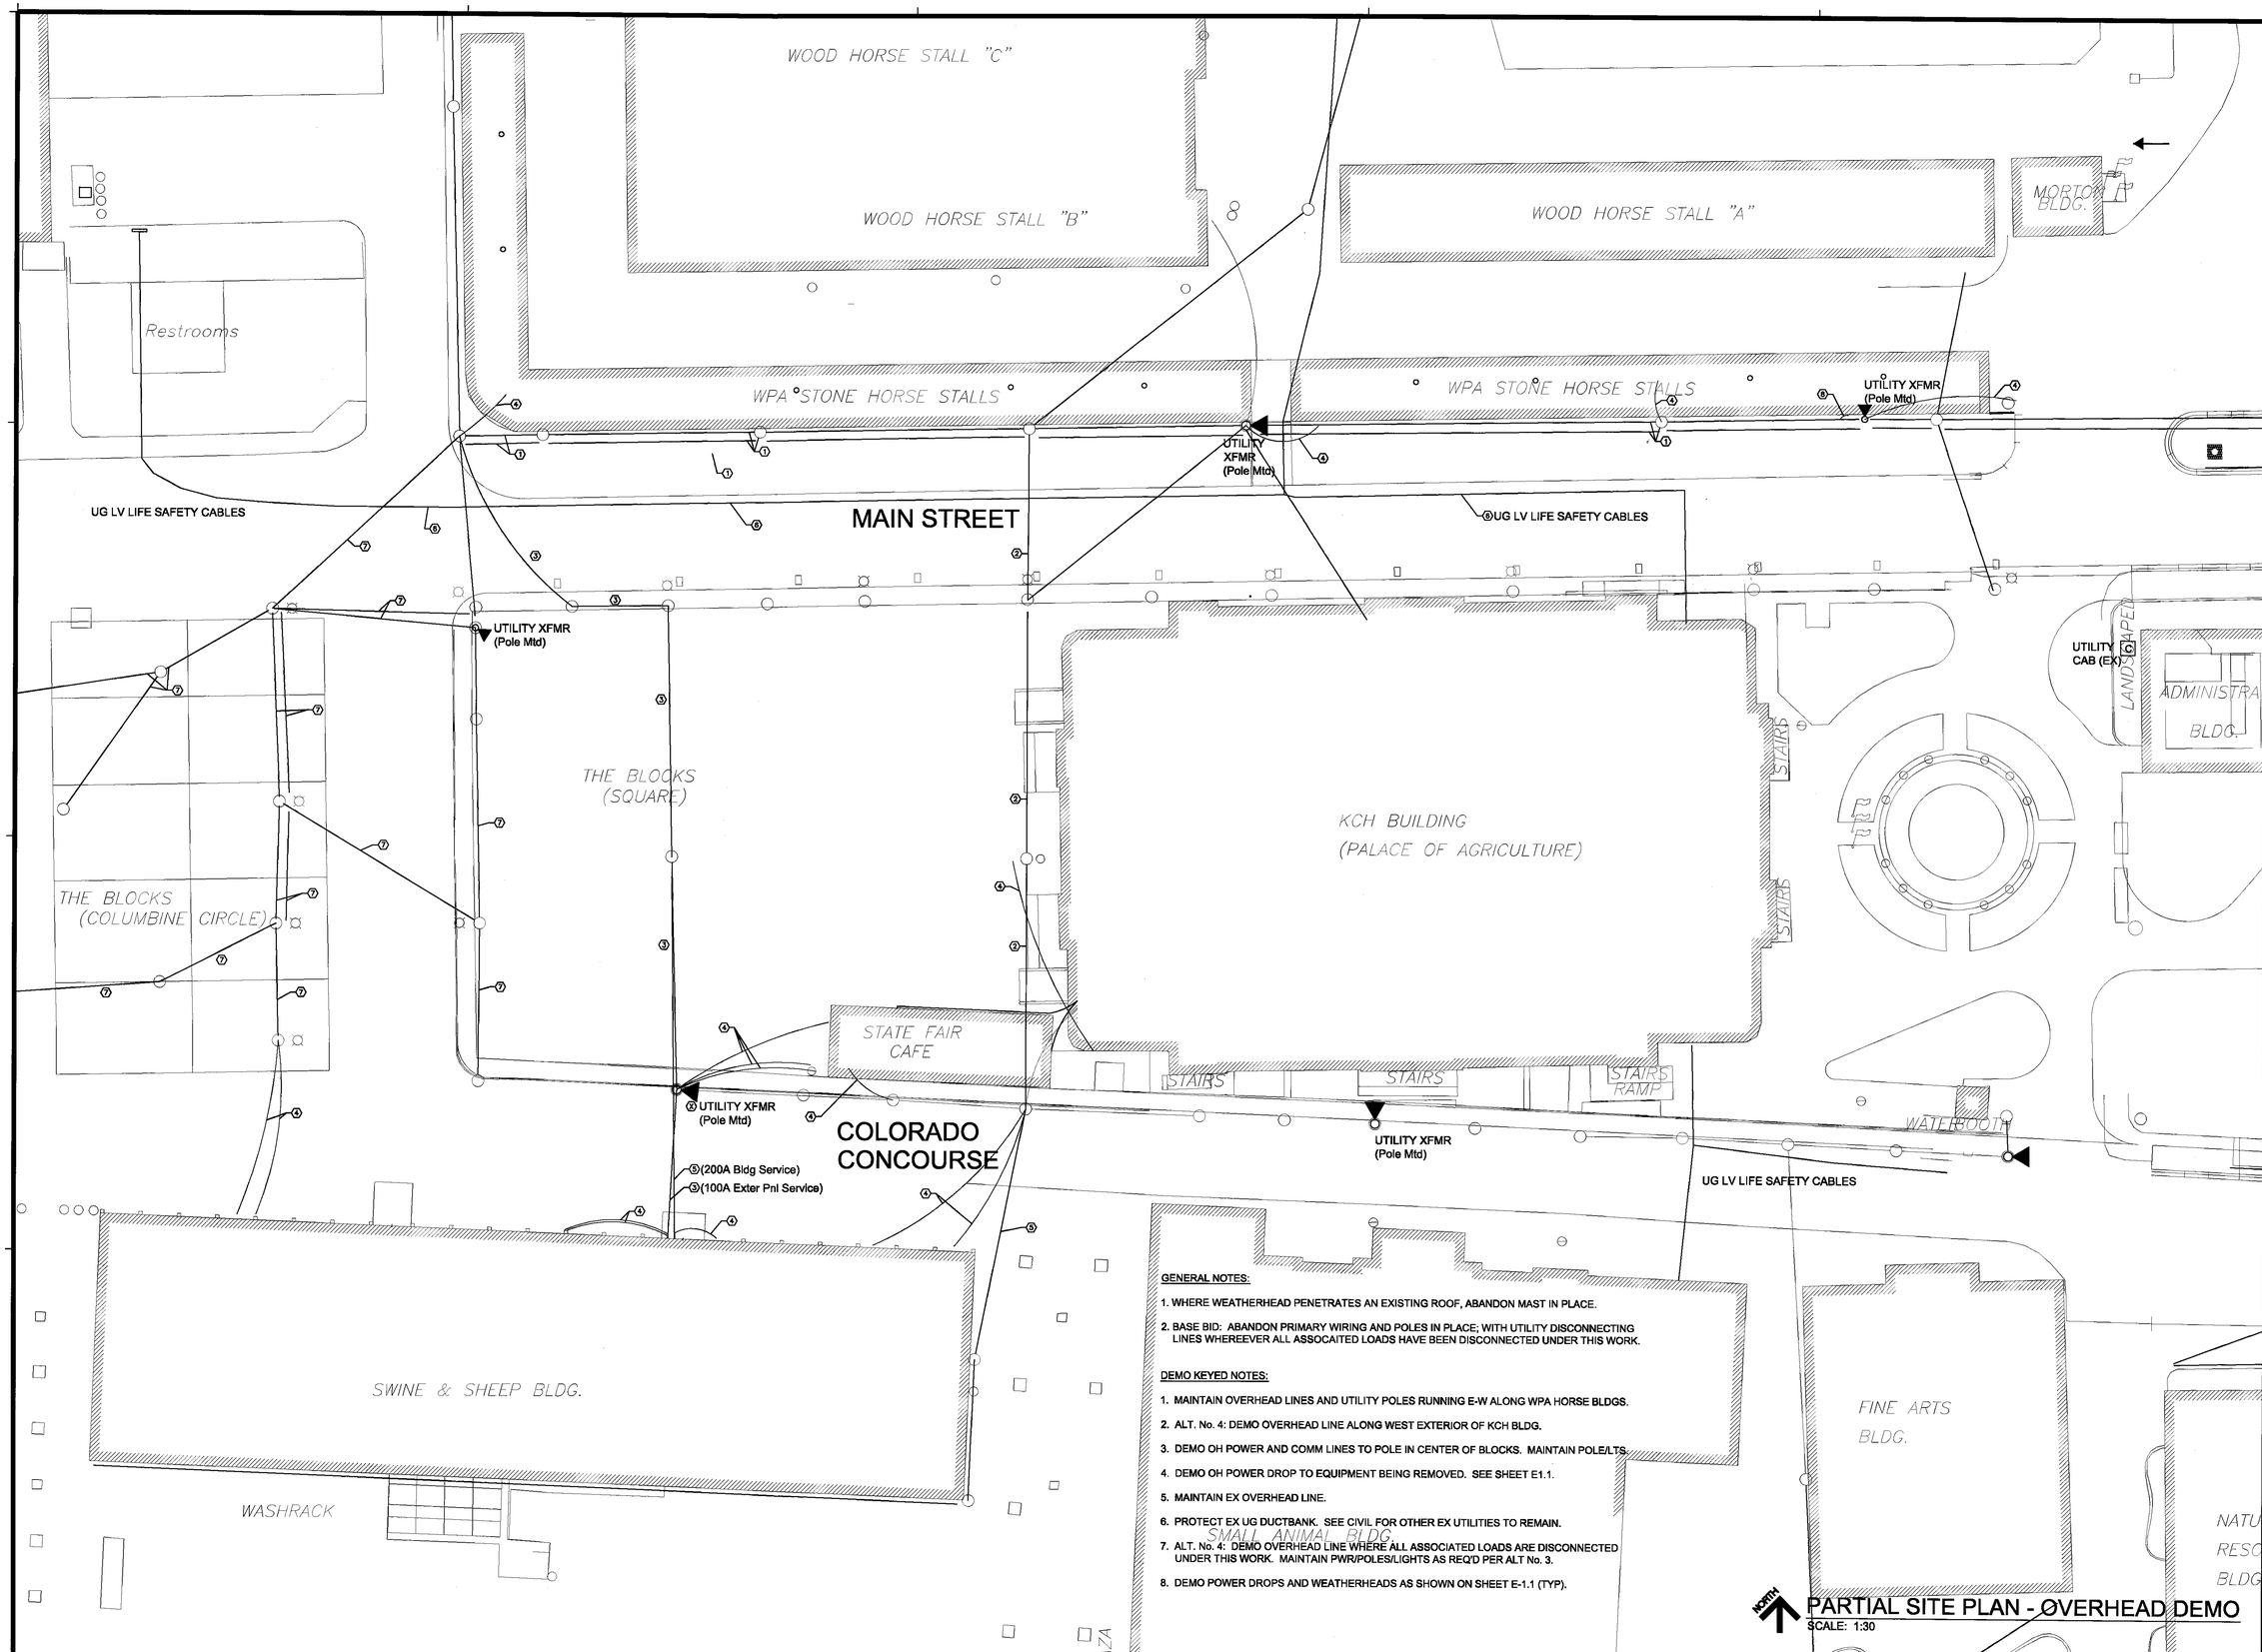

GENERAL NOTES:

1. WHERE WEATHERHEAD PENETRATES AN EXISTING ROOF, ABANDON MAST IN PLACE.
2. BASE BID: ABANDON PRIMARY WIRING AND POLES IN PLACE; WITH UTILITY DISCONNECTING LINES WHEREEVER ALL ASSOCAITED LOADS HAVE BEEN DISCONNECTED UNDER THIS WORK.

DEMO KEYED NOTES:

1. MAINTAIN OVERHEAD LINES AND UTILITY POLES RUNNING E-W ALONG WPA HORSE BLDGS.
2. ALT. No. 4: DEMO OVERHEAD LINE ALONG WEST EXTERIOR OF KCH BLDG.
3. DEMO OH POWER AND COMM LINES TO POLE IN CENTER OF BLOCKS. MAINTAIN POLE/LTS.
4. DEMO OH POWER DROP TO EQUIPMENT BEING REMOVED. SEE SHEET E1.1.
5. MAINTAIN EX OVERHEAD LINE.
6. PROTECT EX UG DUCTBANK. SEE CIVIL FOR OTHER EX UTILITIES TO REMAIN.
7. ALT. No. 4: DEMO OVERHEAD LINE WHERE ALL ASSOCIATED LOADS ARE DISCONNECTED UNDER THIS WORK. MAINTAIN PWR/POLES/LIGHTS AS REQ'D PER ALT No. 3.
8. DEMO POWER DROPS AND WEATHERHEADS AS SHOWN ON SHEET E-1.1 (TYP).

PARTIAL SITE PLAN - OVERHEAD DEMO
SCALE: 1:30

RED ROCK
CONSULTING ENGINEERS
144 Palisade Circle
Manitou Springs, CO
80829
Tel: 719-685-1266
Fax: 719-685-1236

COLORADO REGISTERED PROFESSIONAL ENGINEER
JEFFRY B. TANNER
28627

STATE OF COLORADO 1876

Colorado State Fair
Project M-09003

COLORADO STATE FAIR
REPLACE SECONDARY ELECTRICAL
1001 BEULAH AVE., PUEBLO, CO

SITE PLAN - OVERHEAD DEMO

MARK	REVISION	DATE

PROJECT NO: 09050
STATE PROJ: M-09003
DRAWN: CAD
CHECKED: JBT
ISSUE DATE: 10/7/2010

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE ENGINEER AND SHALL NOT BE USED ON ANY OTHER WORK EXCEPT BY WRITTEN AGREEMENT WITH THE ENGINEER.

E-1.2